

BAR VALVE SYSTEM

SCL1512 (Chrome), SCL1513 (Brushed Brass), SCL1514 (Gunmetal)



MIN. PRESSURE: 0.5 BAR


0.5 BAR 7 l/min

1.0 BAR 8.5 l/min

2.0 BAR 11.5 l/min

All recorded flow rates are from testing under laboratory conditions. Actual flow rate will vary depending on domestic supply.

Diagrams not to scale. All dimensions in mm (tolerance of +/- 5mm).

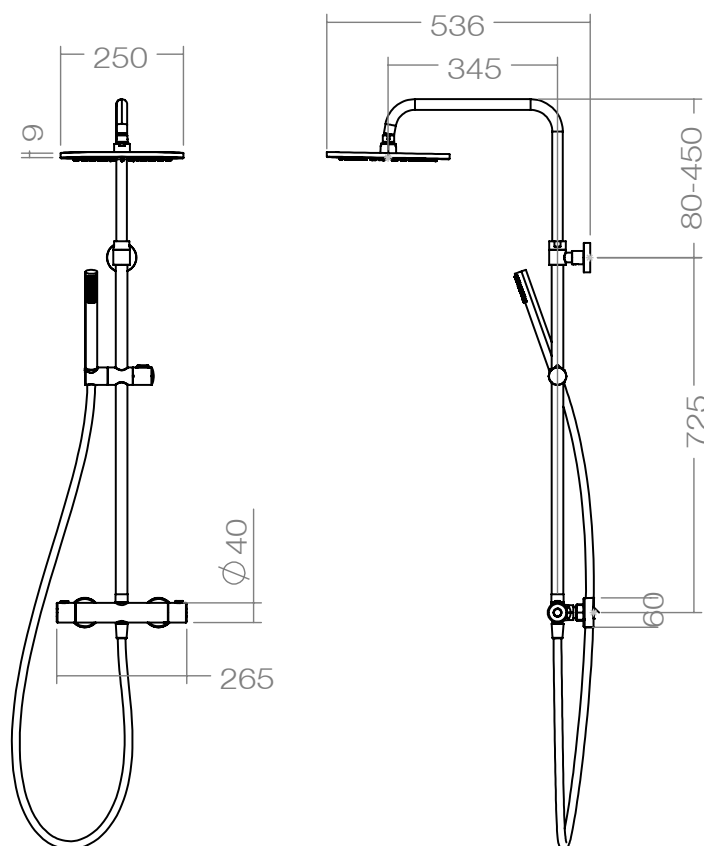

FAQS

What is the recommended minimum pressure?

0.5 Bar.

How tall is the riser rail?

The riser rail has an adjustable height of 805mm to 1175mm

How long is the shower hose?

The shower hose is 1.5m long.

What is the valve inlet connection size?

3/4" BSP - the bar valve comes with a Quick Connection Kit which includes the correct plumbing connection size.

What is the valve outlet connection size?

Both outlets on the bar valve are 1/2" BSP.

BAR VALVE SYSTEM

SCL1512 (Chrome), SCL1513 (Brushed Brass), SCL1514 (Gunmetal)

COMPLIANCE AND STANDARDS:

Designed to be installed in compliance with the Water Supply (Water Fittings) Regulations 1999 (England & Wales; equivalent Scottish Water Byelaws and Northern Ireland byelaws apply in those jurisdictions) — the statutory backing legislation requiring all water fittings to prevent contamination, waste, misuse, undue consumption or erroneous measurement of water.

BS EN 1111:2017

Thermostatic mixing valves (PN 10) — general technical specification (typical for high-pressure/combi/unvented systems).

BS EN 1112:2008 / BS EN 1113:2015

General specification for electrodeposited coatings of Ni-Cr (nickel-chrome plating) on taps and fittings.

BS EN 1287:2017

Low-pressure thermostatic mixing valves — general technical specification (typical for gravity-fed/low-pressure shower valves).

WRAS APPROVAL NUMBER

260512321

Designed to be installed in compliance with the Water Supply (Water Fittings) Regulations 1999 (England & Wales; equivalent Scottish Water Byelaws and Northern Ireland byelaws apply in those jurisdictions) — the statutory backing legislation requiring all water fittings to prevent contamination, waste, misuse, undue consumption or erroneous measurement of water.